


C:\PDX\Projects\07\0876\000\District Standards for Design Drawings\REWD STANDARD WATER SERVICE 1-25-10.dwg Model 2/17/2011 8:32 AM ENG04D 1B.1a (LMS Tech)



NOTES:

1. SEE SECTION 02619 OF THE CITY OF LAKE OSWEGO TECHNICAL SPECIFICATION FOR APPROVED MATERIALS OF CONSTRUCTION.
2. METER BOXES SHALL BE ARMORCAST ROTOCAST 13"x24"x12" WITHOUT MOUSE HOLES, 13"x24" COVER TO INCLUDE 5"x7" DROP-IN LID. IF PLACED IN A TRAFFIC AREA USE TRAFFIC RATED METER BOX AND PLACE BOX IN CONCRETE.
3. METER BOX TO BE INSTALLED AT THE SAME TIME AS SERVICE LINE INSTALLATION.
4. SEE PLANS FOR SERVICE LINE DIAMETERS, SIZE CURB & CORPORATION STOPS TO MATCH LINE DIAMETERS.
5. A STRAIGHT METER COUPLER (NOT DEPICTED ON THIS DRAWING) IS REQUIRED AND SHALL BE PROVIDED BY DEVELOPER/APPLICANT AT TIME OF METER INSTALLATION.

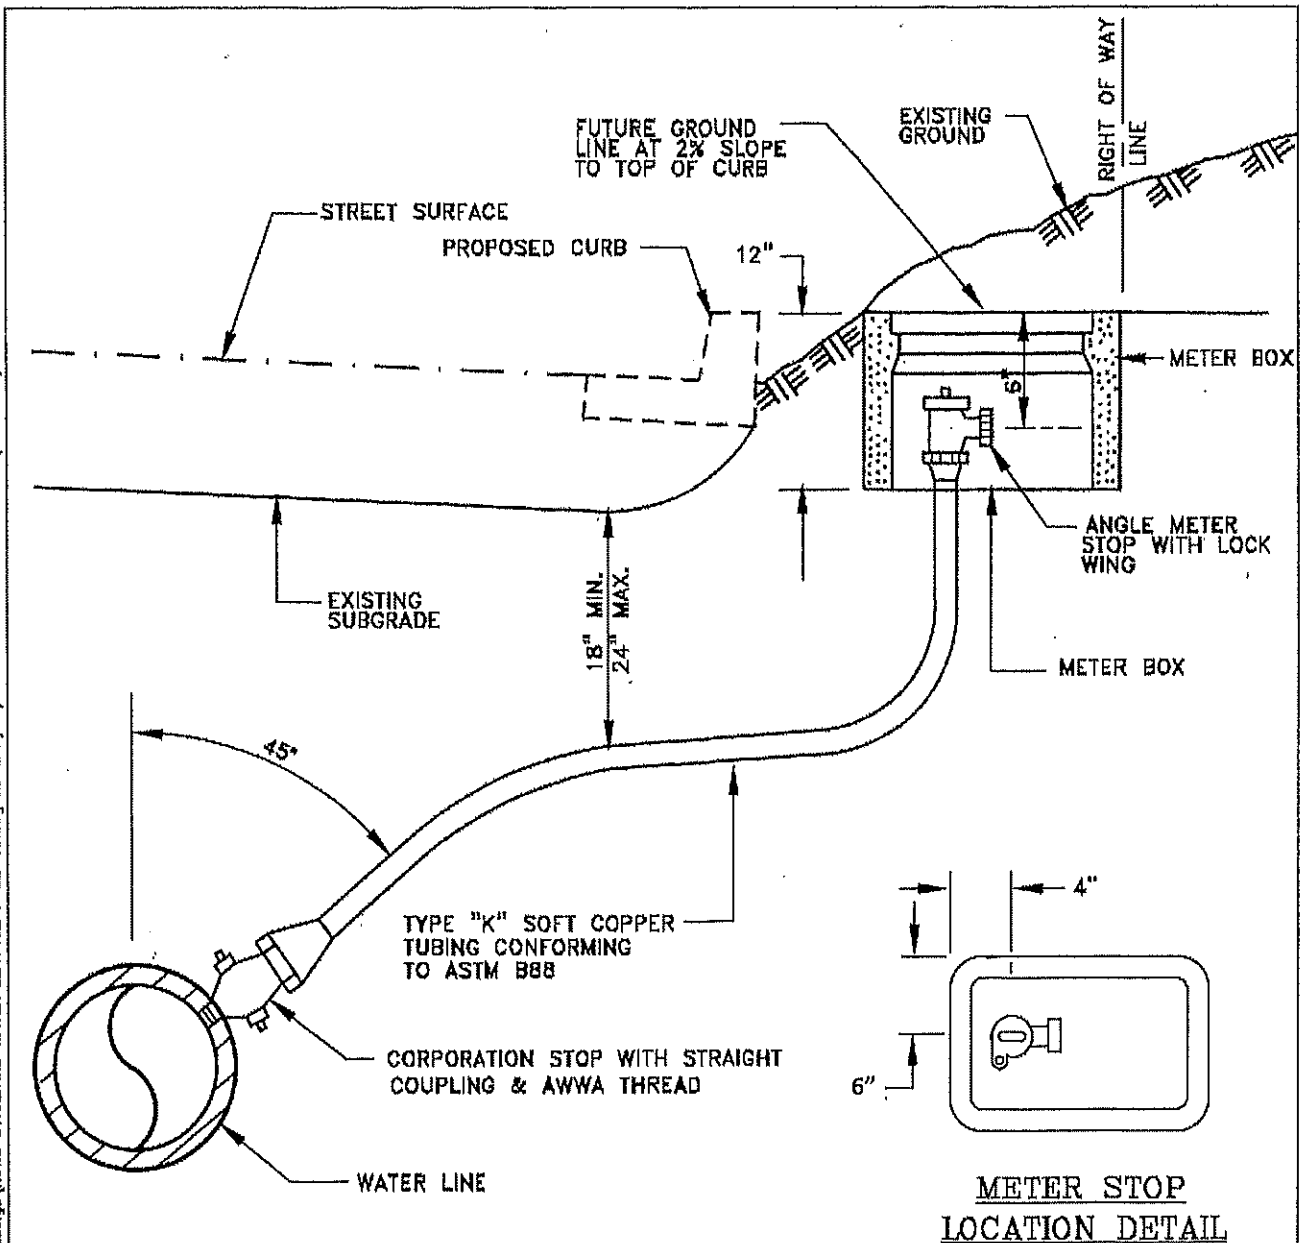

**RIVERGROVE
WATER DISTRICT**

**STANDARD WATER
SERVICE CONNECTION**

DATE 6/2023
SCALE N.T.S.
DWG NO. W-1.01